

# CITY OF SAUSALITO

Sausalito, CA 94965

## Addendum No. 1

Notice Issued June 05, 2015

For

### ACCESSIBILITY IMPROVEMENT PROJECT 2015; BID PACKAGE 4B—BRIDGEWAY SOUTH

#### NOTICE TO ALL PLAN HOLDERS SUBMITTING BIDS FOR THIS WORK:

You are hereby notified of the following information, changes, clarifications or modifications to the original Contract Documents, Project Manual, Drawings, Specifications and subsequent Addenda. The Addendum shall supersede the original Contract Documents and previous Addenda wherein it contradicts the same and shall take precedence over anything to the contrary therein. All other conditions remain, UNCHANGED.

This Addendum is hereby made a part of the Contract Documents to the same extent as though it were originally included therein.

#### Revision:

#### Special Provisions Page P-3 - Bid Form

<b>Item #4</b> Minor Concrete-Curb Ramps, including retaining curbs (if any), and adjacent landings and sidewalk	<b>3,221 SF</b>
<b>Item #7</b> Detectable Warning Surface Tiles	<b>630 SF</b>

#### Bid Package 4B Estimated Quantities

<b>Item # BW 15-02</b> Truncated Domes	<b>60 SF</b>
<b>Item # BW 20-02</b> Truncated Domes	<b>105 SF</b>
<b>Item # BW 20-03</b> Truncated Domes	<b>99 SF</b>
<b>Item # BW 20-08</b> Standard Curb Ramp	<b>346 SF</b>
<b>Item # BW 20-08</b> Seeded Curb Ramp	<b>0 SF</b>
<b>TOTALS</b> Standard Curb Ramp	<b>3,221 SF</b>
<b>TOTALS</b> Seeded Curb Ramp	<b>0 SF</b>
<b>TOTALS</b> Truncated Domes	<b>630 SF</b>

**Bid Package 4B Details**

**Item # BW 15-02** Note 3 added.

**Item # BW 20-02** Note 3 added.

**Item # BW 20-03** Note 3 added.

**End of Revision**

**END OF ADDENDUM NO. 1**

**ACKNOWLEDGED**

\_\_\_\_\_  
**Bidder's Signature**

**A signed copy of this addendum is to be submitted as a part of the bid package for the subject project. Failure to do so may subject the Bidder to Disqualification.**

**CITY OF SAUSALITO  
ACCESSIBILITY IMPROVEMENT PROJECT 2015—BRIDGEWAY SOUTH**

Proposal of \_\_\_\_\_ (hereinafter called "BIDDER"), organized and existing under the laws of the State of \_\_\_\_\_, doing business as \_\_\_\_\_ \*to the CITY OF SAUSALITO (hereinafter called "OWNER").

In compliance with your Advertisement for Bids, BIDDER hereby proposes to perform all WORK for the construction of **ACCESSIBILITY IMPROVEMENT PROJECT 2015—BRIDGEWAY SOUTH** in strict accordance with the CONTRACT DOCUMENTS, within the time set forth therein, and at the prices stated below.

By submission of this BID, each BIDDER certifies, and in the case of a joint BID each party therein certifies as to his own organization, that this BID has been arrived at independently, without consultation, communication, or agreement as to any matter relating to this BID with any other BIDDER or with any competitor.

BIDDER hereby agrees to commence WORK under this contract within five (5) days of the date to be specified in the NOTICE TO PROCEED and to fully complete the PROJECT within thirty-five (35) consecutive working days. BIDDER further agrees to pay as liquidated damages, the sum of \$1,000 for each consecutive working day thereafter as provided in Section 5.06 of the standard specifications.

BIDDER acknowledges receipt of the following ADDENDUM:

---



---



---

BIDDER agrees to perform the work described in the CONTRACT DOCUMENTS for the unit prices or lump sum prices stated on the attached BID SCHEDULE.

<b>Item</b>	<b>Description</b>	<b>QTY</b>	<b>UNIT</b>	<b>UNIT PRICE</b>	<b>EXTENDED PRICE</b>
<b>1</b>	Mobilization	<b>1</b>	<b>LS</b>		
<b>2</b>	Traffic Control	<b>1</b>	<b>LS</b>		
<b>3</b>	Demolition	<b>1</b>	<b>LS</b>		
<b>4</b>	Minor Concrete-Curb Ramps, including retaining curbs (if any), and adjacent landings and sidewalk	<b>3221</b>	<b>SF</b>		
<b>5</b>	Minor Concrete-Curb & Gutter	<b>457</b>	<b>LF</b>		
<b>6</b>	Minor Concrete-Curb	<b>4</b>	<b>LF</b>		
<b>7</b>	Detectable Warning Surface Tiles	<b>630</b>	<b>SF</b>		
<b>8</b>	Asphaltic Concrete	<b>1457</b>	<b>SF</b>		
<b>9</b>	Brick Paving	<b>1</b>	<b>LS</b>		
<b>10</b>	Marin UCS Type C catch basin frame/grate	<b>8</b>	<b>EA.</b>		
<b>TOTAL – BASE BID</b>					

Item #	Location	Standard Curb Ramp <sup>1</sup> SF	Seeded Curb Ramp <sup>1</sup> SF	Concrete Finish <sup>2</sup> TYPE	Curb and Gutter <sup>3</sup> LF	AC SF	TRUNCATED DOMES SF	Grate TYPE	Frame TYPE
BW 15-02	Bridgeway/Napa St., SE	-	-		28	56	60		
BW 15-03	Bridgeway/Napa St., NE	282	-	LW	40	86	15		
BW 15-07	Bridgeway/Off Ramp to Napa St., West	-	-		24	48	-		
BW 15-08	Bridgeway/Off Ramp to Napa St., East	120	-	LW	-	68	33		
BW 15-09	Bridgeway/Napa St., NW	254	-	LW	-	56	30		
BW 15-10	Bridgeway/Napa St., SW	222	-	MW	41	85	15		
BW 16-03	Bridgeway/Bee St., SE	470	-	LW	14	28	39		
BW 18-03	Bridgeway/Locust St., NW	150	-	LW	17	34	12	TYPE C	TYPE C
BW 18-04	Bridgeway/Locust St., NW	100	-	LW	20	40	12		
BW 18-05	Bridgeway/Locust St., SW	-	-		-	-	-	TYPE C	TYPE C
BW 20-02	Bridgeway/Pine St., SE	-	-		37	80	105		
BW 20-03	Bridgeway/Pine St., NE	-	-		33	70	99		
BW 20-08	Bridgeway/Pine St., NW	346	-	MW	28	112	45	TYPE C	TYPE C
BW 20-09	Bridgeway/Pine St., SW	273	-	LW	32	72	39	TYPE C	TYPE C
BW 21-02	Bridgeway/Johnson St., SE	100	-	LW	20	46	12	TYPE C	TYPE C
BW 21-04	Bridgeway/Johnson St., NE	322	-	LW	40	90	51	TYPE C	TYPE C
BW 21-12	Bridgeway/Johnson St., SW	232	-	LW	33	70	36	TYPE C	TYPE C
BW 22-08	Bridgeway/Caledonia St., NW	150	-	MW	20	46	15	TYPE C	TYPE C
BW 22-09	Bridgeway/Caledonia St., SW	200	-	LW	30	60	12		
PSP-05	Pine/Caledonia St., NE	-	-		-	310	-		
<b>TOTALS</b>		<b>3,221</b>	<b>-</b>		<b>457</b>	<b>1,457</b>	<b>630</b>	<b>8</b>	<b>8</b>

<sup>1</sup> Includes curb ramp, landing area, retaining curbs, and upper landings, and area that is warped to conform to <E> sidewalk (Transition Areas) as required.


<sup>2</sup> BF = Broom Finish  
 LW = Light Wash  
 MW = Medium Wash  
 EA = Exposed Aggregate  
 SEED = Seeded Aggregate

<sup>3</sup> Includes Curb and Gutter along ramps, landings, and transition areas as necessary;  
 Does not include retaining curbs constructed as part of ramp.

## BW 15-02




1. Remove <E> curb and gutter as shown.
2. Install <N> curb and gutter with 24" gutter pan with no lip at max 5% slope in running direction of crosswalk for entire width of ramp as shown.
3. Install detectable warning surface at existing ramp per General Notes.

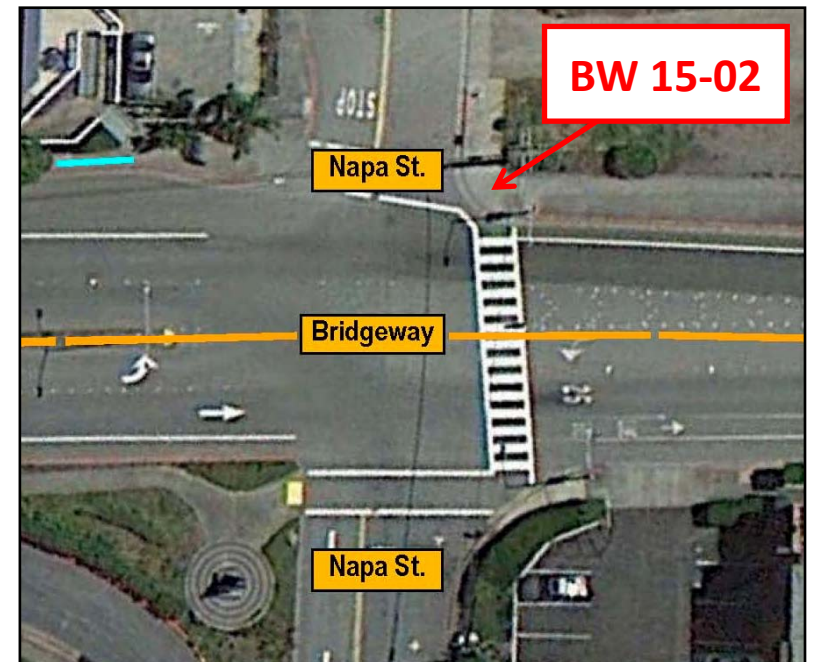

## BW 20-02



1. Remove <E> curb and gutter as shown.
2. Install <N> curb and gutter with 24" gutter pan with no lip and max 5% slope in running direction of crosswalk for entire width of ramp as shown.
3. Install detectable warning surface at existing ramp per General Notes.

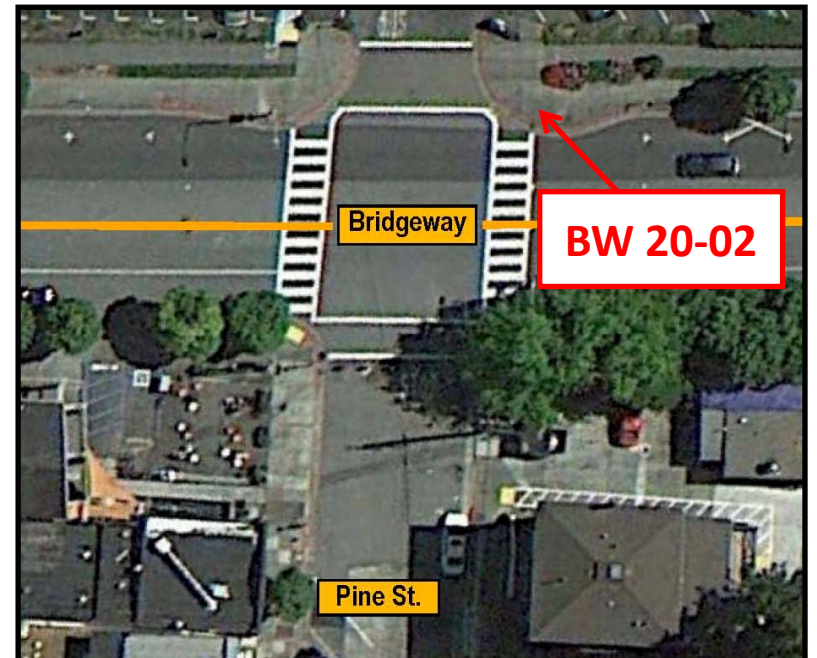

## BW 20-03



1. Remove <E> curb and gutter as shown.
2. Install <N> curb and gutter with 24" gutter pan with no lip and max 5% slope in running direction of crosswalk for entire width of ramp as shown.
3. Install detectable warning surface at existing ramp per General Notes.

